


# Fire Alarm Panel

## Firemans Talk Back Panels

Model: ANL-64 FTC.1






ANISO9001: 2008COMPANY-

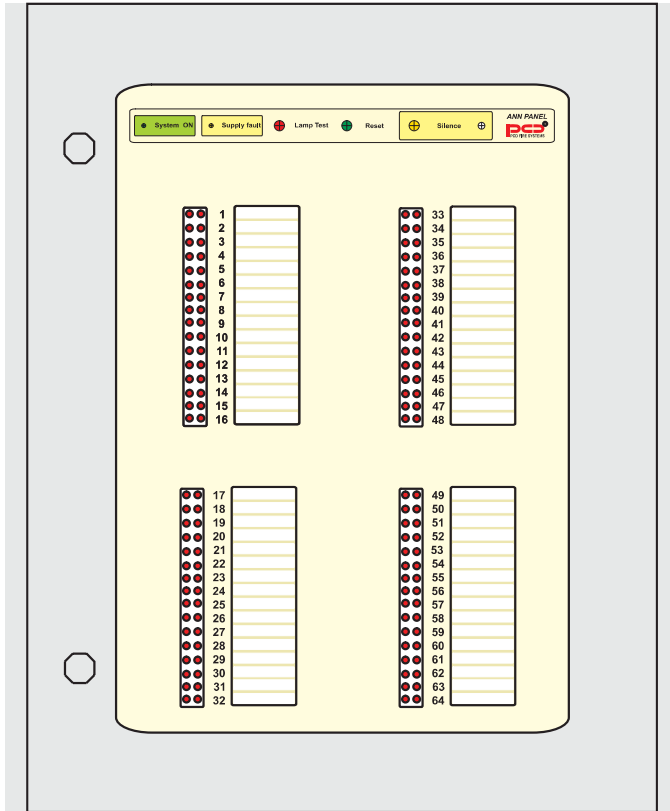

### MODEL : ANL-64 FTC.

64 Zone 4 loop Panel  
Supply: 230v AC.  
System Voltage: 24v DC.  
Max Current: 2 Amps  
Battery: 24v DC. VRLA.  
Battery Charger: Float.  
Alarm Location Dual LED.  
Alarm will sound with Flashing LED when call is received. After lifting hand set Alarm will silence and contact is established.  
Multiple calls will automatically go into conference mode.

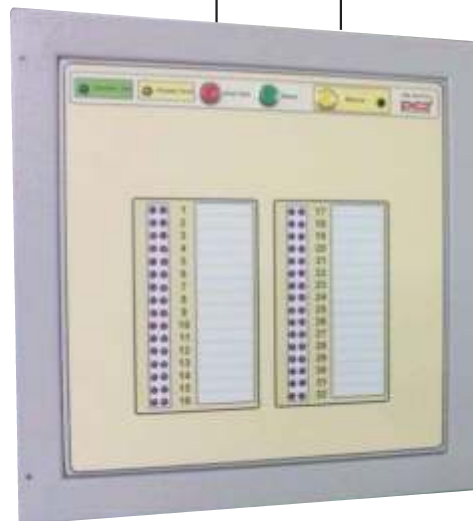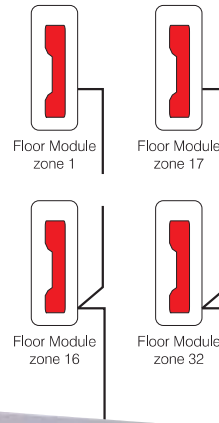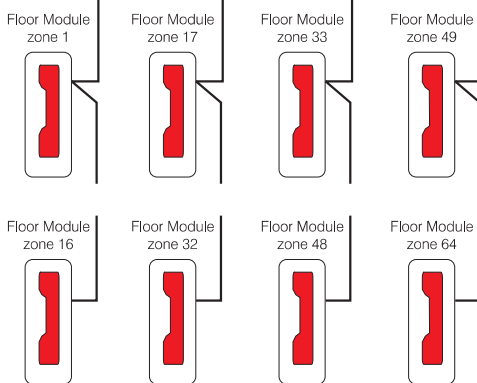

### Model : ANL-64 FTC. 1 32 Zone 2 Loop Panel

☎ 022 41205036 / 022 25003210 | CEO: Joseph Rozario: 9930533861

✉ sales@pcdfire.co.in info@linovate.in 🌐 www.pcdfire.co.in

**Head Office** - Ground Floor, C-15 Kailash Esplanade, L.B.S. Marg, Ghatkopar (w), Mumbai 400086

**Works** - Ghatkopar Industrial Estate, B/h R-City Mall, L.B.S. Marg, Ghatkopar (w), Mumbai 400086



# Fire Alarm Panel

## Firemans Talk Back Panels

Model: ANL-64 FTC.1



ANISO9001: 2008COMPANY-

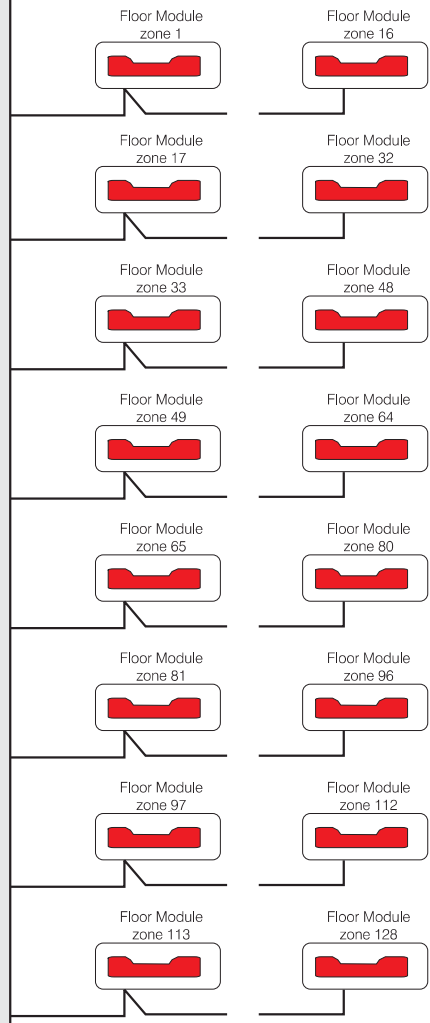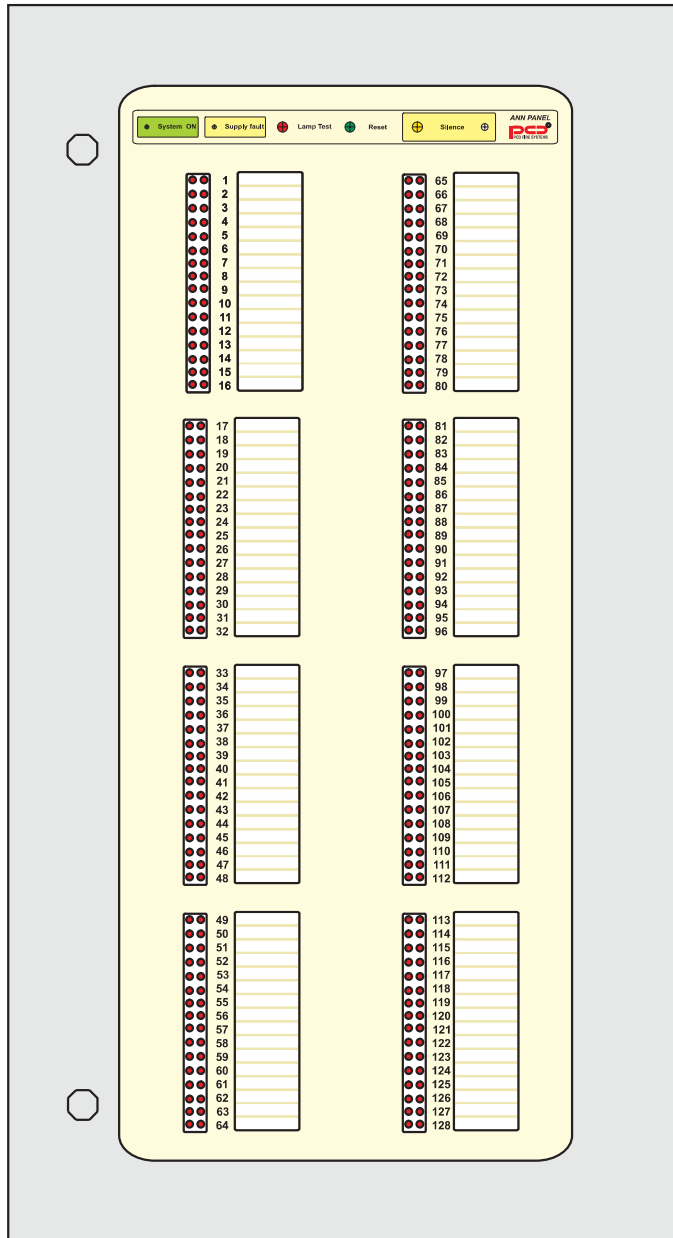

Model: ANL-128-FTC.1

### 128 Zone 8 loop Panel

Supply 230v AC. System Voltage: 24v DC - Max current: 6 Amps - Battery: 24c DC. VRLA. Charger: Float.

Alarm Location Dual LED.

Alarm will sound with Flashing LED when call is recieved. After lifting hand set Alarm will silence and contact is established.

☎ 022 41205036 / 022 25003210 | CEO: Joseph Rozario: 9930533861

✉ sales@pcdfire.co.in info@linovate.in 🌐 www.pcdfire.co.in

**Head Office** - Ground Floor, C-15 Kailash Esplanade, L.B.S. Marg, Ghatkopar (w), Mumbai 400086

**Works** - Ghatkopar Industrial Estate, B/h R-City Mall, L.B.S. Marg, Ghatkopar (w), Mumbai 400086